

Customer: Date: 8/14/2017  
 Contact: From:  
 Telephone: Company:  
 Cell: Return Tel:  
 Fax: Return Fax:  
 Job:  
 Quote #:

**Construction**

Item: CWC5-3  
 Coils Per Bank: 1  
 Allow Opp. End: No  
 Tube OD IN: 5/8  
 Coil Duty: Cool-Standard  
 Fins Per Inch: 10  
 Rows: 4  
 Fin Surface: B  
 Fin Height (IN): 55.50  
 Finned Length (IN): 67.00  
 Tubing Mat. (IN): 0.020 Copper  
 TurboSpirals: No  
 Fin Mat. (IN): 0.0075 Aluminum  
 Conn Qty/Size (IN): 1 / 3.00  
 Circuiting: Single  
 Face Area (SQ FT): 25.82

**Air Side**

Air Flow (Sft<sup>3</sup>/min) 14000.0  
 Altitude FT: 0.00  
 Ent. Air DB/WB °F: 95.00 / 78.00  
 Lvg. Air DB/WB °F: 0.00 / 54.00  
 Total / Sensible MBH: 480.0 / 0.00  
 Max Air PD "H2O: 0.00  
 Fin Fouling Factor ft<sup>2</sup>-°F-hr/BTU: 0

**Fluid Side**

Fluid Type: Propylene  
 Percent Glycol: 20  
 Ent. Fluid : 45.00  
 Lvg. Fluid : 55.00  
 Fluid Flow gal/min: 0.00  
 Max FPD FT H2O: 0.00  
 Fouling Factor ft<sup>2</sup>-°F-hr/BTU: 0

OUTPUT DATA		Most Economical			Specified Coil		
		Coil 1	Coil 2	Coil 3	Coil 4 ✓	Coil 5	Coil 6
Model Number:					5WS1004B		
FPI   Rows   Surf:					10   04   B		
Circuiting:					1		
Air Velocity:	(Sft/min)				542.2		
Total Capacity:	MBH				583.8		
Sens. Capacity:	MBH				379.3		
Lvg. Air DB:	°F				70.22		
Lvg. Air WB:	°F				67.52		
Standard APD	"H2O				0.53		
Lvg. Fluid:	°F				57.16		
Fluid Flow:	gal/min				99.09		
Fluid PD:	FT H2O				4.86		
Fluid Vel.:	ft/s				2.86		
Conn Size:	IN				(1) 3.000		
Internal Volume:	in <sup>3</sup>				3859.0		
Weight (Dry):	lbm				340.3		
Weight (w/Fluid):	lbm				487.2		
Notes:					AL		

**Notes:**


A) Certified in accordance with the AHRI Forced-Circulation Air-Cooling and Air-Heating Coils Certification Program which is based on AHRI Standard 410 within the Range of Standard Rating Conditions listed in Table 1 of the Standard. Certified units may be found in the AHRI Directory at [www.ahridirectory.org](http://www.ahridirectory.org).  
 L) Coil rating valid for Heatcraft coils only.

Customer:  
Contact:  
Telephone:  
Cell:  
Fax:  
Job:  
Quote #:

Date: 8/14/2017  
From:  
Company:  
Return Tel:  
Return Fax:

ITEM	QTY	MODEL NUMBER						HAND
		TYPE	FPI	ROWS	FIN	FH (IN)	FL (IN)	
CWC5-3	1	5WS	10	04	B	55.50	67.00	Left

MATERIALS OF CONSTRUCTION		OPTIONS				
Fins	0.0075 Aluminum	Coating	None		TurboSpirals	No
Tubes	0.020 Copper	Casing Type	Flanged		Moisture Eliminator	No
Casing	Galvanized Steel	Vent & Drain	.50 FPT on End Cap		Mounting Holes	No
Conn. Material	Carbon Steel				Label Kit	Yes
Conn. Type	MPT				Drain Headers	No
Conn. Size	3.00				Tube Ferrules	No
Weight (LBS)	340.0					

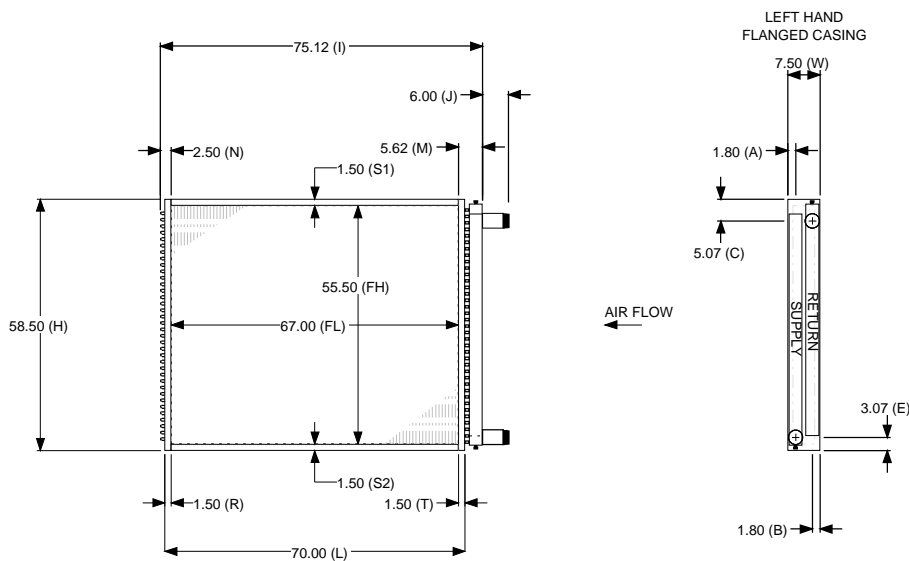

DIMENSIONAL DATA(IN)																
A	B	C	D	E	F	H	I	J	L	M	N	R	S1	S2	T	W
1.80	1.80	5.07	0.00	3.07	0.00	58.50	75.12	6.00	70.00	5.62	2.50	1.50	1.50	1.50	1.50	7.50

**NOTES:**

**GENERAL NOTES:**

1. All dimensions are in (in)
2. Manually verifying dimensions is highly recommended.
3. One intermediate tube support fabricated from stock of the same material as the casing will be provided.
4. The supply line should be connected to the lower connection on the leaving air side for counterflow operation.
5. Coils will vent and drain through factory-installed vent and drain fittings when mounted level for horizontal flow.
6. Connection location other than standard could affect vent and drain locations. Consult factory.